

Figure 1: Filter shown without manual by-pass valve.

Figure 2: Filter shown with manual bypass valve.

**ORG/A-040-LS SHOWN,
ORG/A-030-LE is Similar**

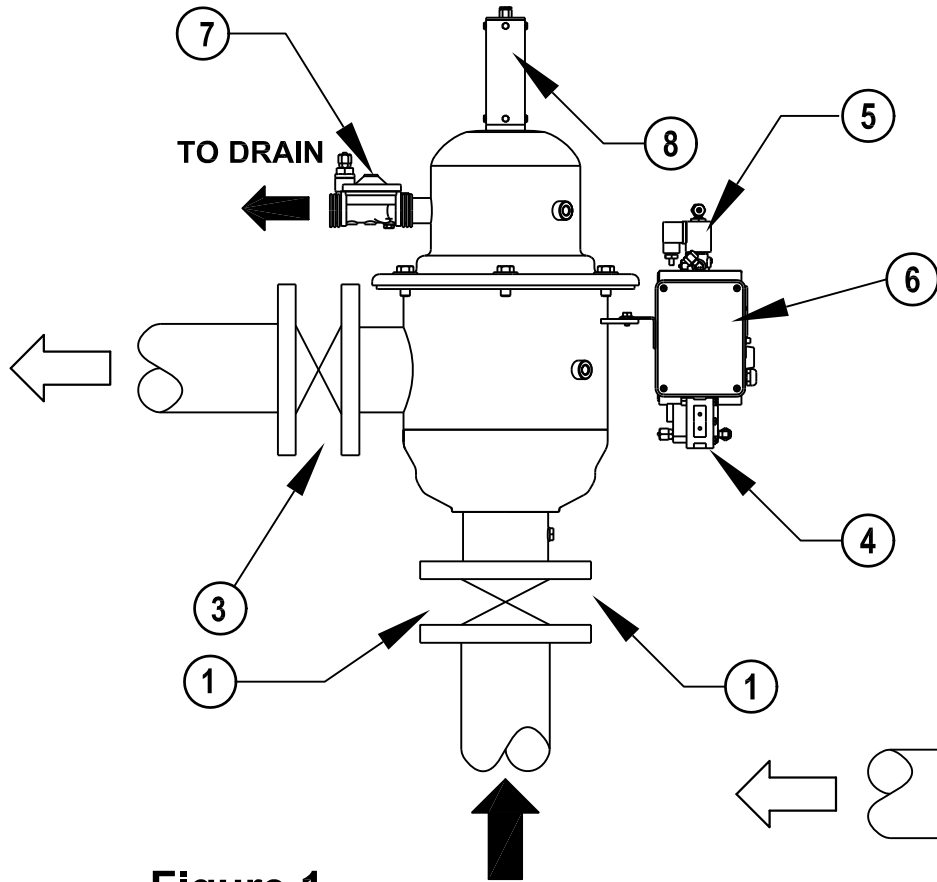


Figure 1

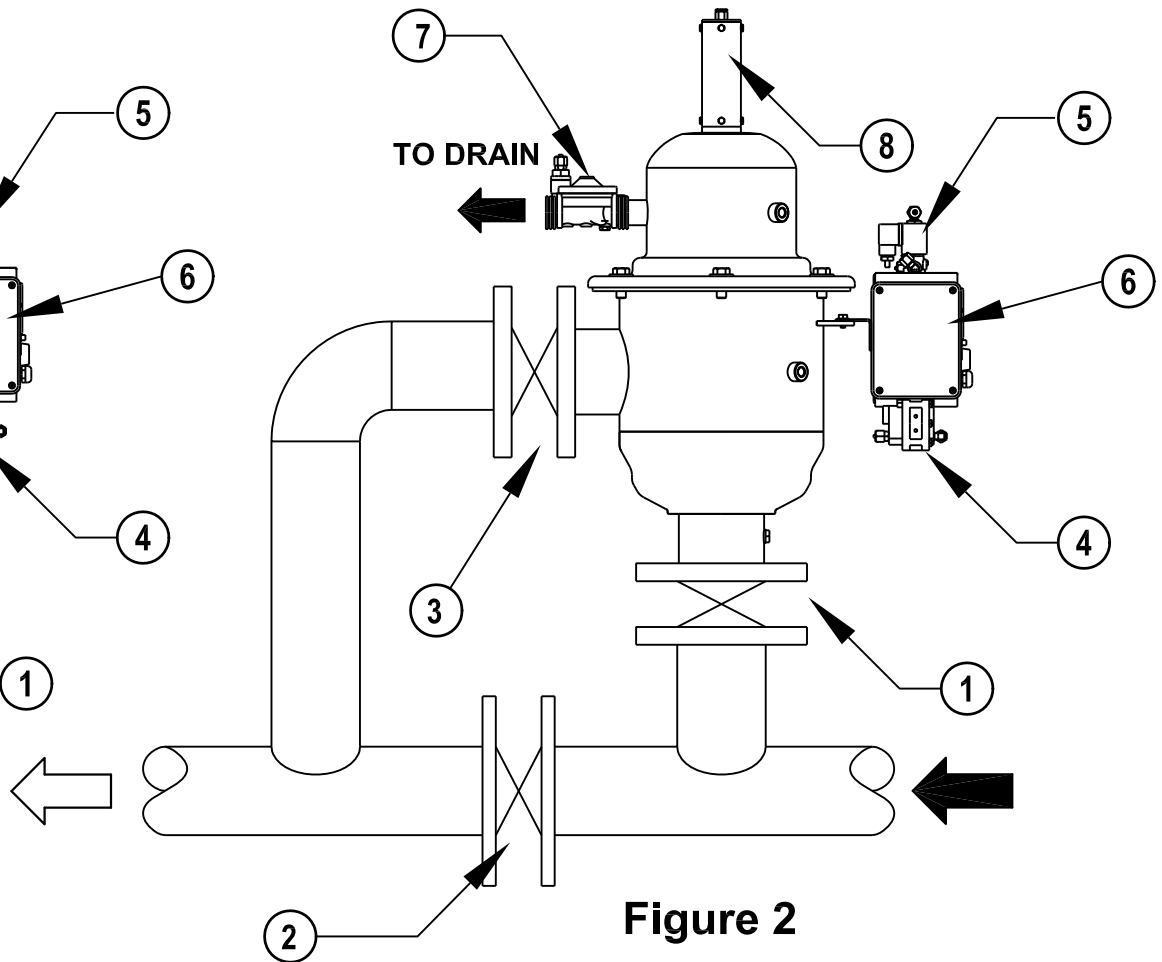


Figure 2

NOTE: Drain Line from the Rinse Valve Should have a Coupling to Allow Easy Removal of the Top Section of the Body During Maintenance.

8	Hydraulic Piston	Connect to the Solenoid
7	1" Rinse Valve	Pipe to 1" or Larger Drain
6	Controller	Mounted on Filter Housing Can be Remote Mounted
5	Solenoid Valve	24 V, 60 Hz, 3 way N.O.
4	Differential Pressure Switch	Preset to 7 psi
3	Outlet Valve	Customer Supplied
2	System Bypass Valve	Customer Supplied
1	Inlet Valve	Customer Supplied
No.	Description	Notes

DWG. NO. 2026-1	SCALE: NONE	ORIVAL, INC. 213 S. VAN BRUNT ST. ENGLEWOOD, N.J. 07631 TEL (201) 568-3311, FAX (201) 568-1916
DRAWN BY: G KALINOWSKI	DATE: 11/30/10	
		ORG/A 3" & 4" FILTERS TYPICAL INSTALLATION LAYOUT