

Figure 1: Filter shown without manual by-pass valve.

Figure 2: Filter shown with manual by-pass valve.

**ORG-020-LE SHOWN
ORG-015-LE IS SIMILAR**

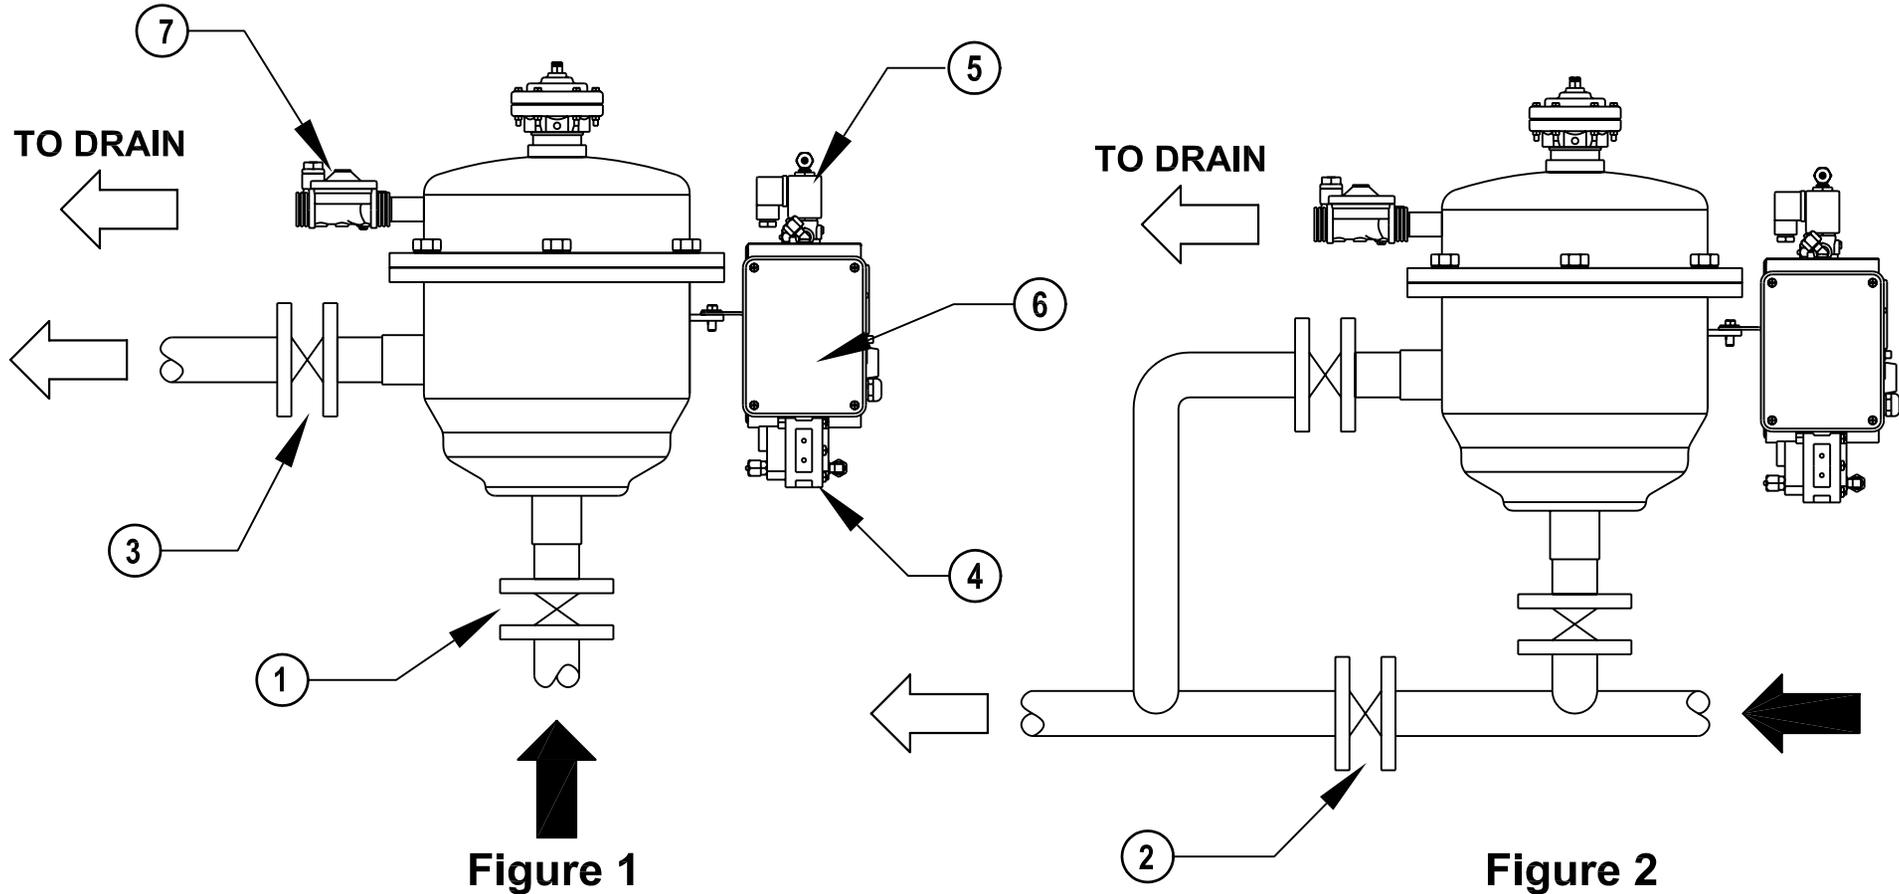


Figure 1

Figure 2

7	1" Rinse Valve	Pipe to 1" or Larger Drain	DWG. NO. 2025	SCALE: NONE	ORIVAL, INC. 213 S. VAN BRUNT ST. ENGLEWOOD, N.J. 07631 TEL (201) 568-3311, FAX (201) 568-1916
6	Controller	Mounted on Filter Housing Can be Remote Mounted			
5	Solenoid Valve	24 V, 60 Hz, 3 way N.O.			
4	Differential Pressure Switch	Preset to 7 psi	DRAWN BY: G KALINOWSKI	DATE: 4/02/07	
3	Outlet Valve	Customer Supplied			
2	System Bypass Valve	Customer Supplied	ORG 1-1/2" & 2" FILTER TYPICAL INSTALLATION LAYOUT		
1	Inlet Valve	Customer Supplied			
No.	Description	Notes			