

Figure 1: FILTER SHOWN WITHOUT BYPASS

Figure 2: FILTER SHOWN WITH BYPASS

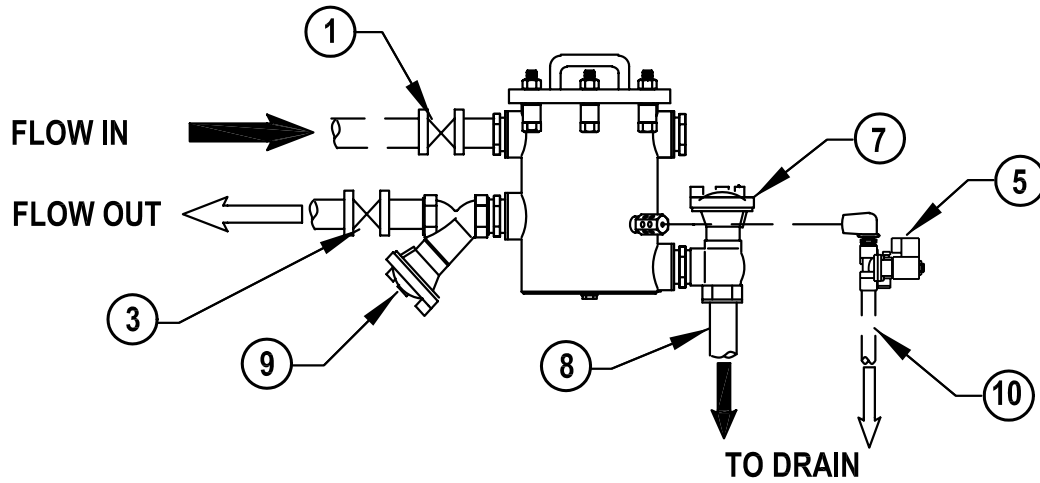


FIGURE 1


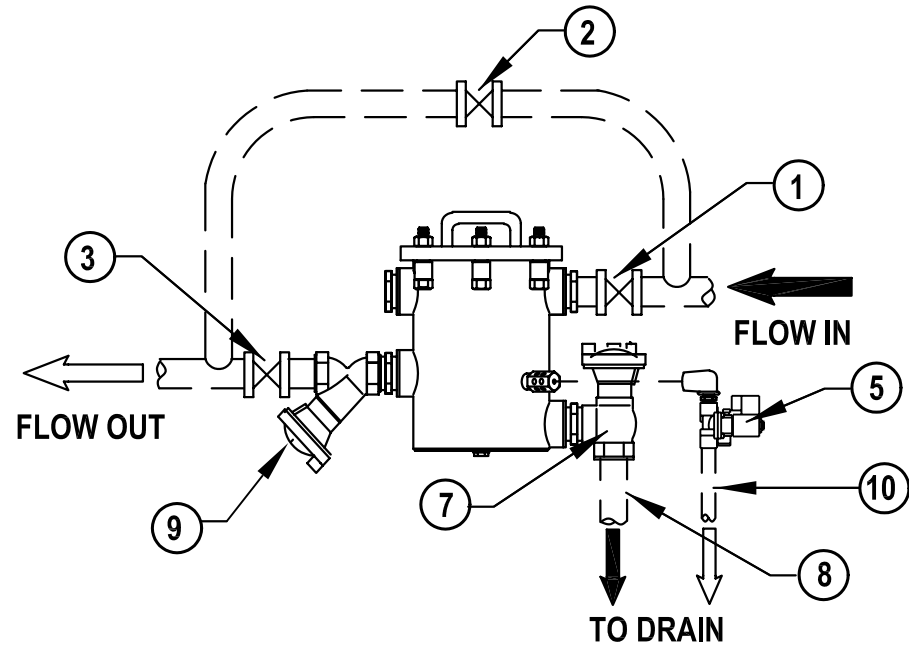


FIGURE 2

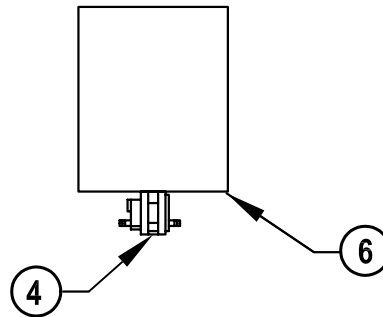

10	1/2" Drain Line	Customer Supplied
9	Controlled Outlet Valve	Solenoid Controlled
8	2 Inch Drain Line	Customer Supplied
7	Rinse Valve	Solenoid Controlled
6	OMNITROL Controller	Remotely Mounted
5	2-Way Solenoid Valve	24 V, 60 Hz, Normally Closed
4	Differential Pressure Switch	Preset to 7 psi - increasing
3	Outlet Isolation Valve	Customer Supplied
2	Manual Bypass Valve	Customer Supplied
1	Inlet Isolation Valve	Customer Supplied
No.	Description	Notes

DWG. NO. 1025	SCALE: NONE	ORIVAL, INC. 213 S. VAN BRUNT ST. ENGLEWOOD, N.J. 07631 TEL (201) 568-3311, FAX (201) 568-1916 www.orival.com filters@orival.com
DRAWN BY: G KALINOWSKI	DATE: 05/26/05	
		INSTALLATION LAYOUTS FOR A MODEL OR-02-PE FILTER